work of Providing and laying 100mm/150mm dia water pipe line in place of 75 mm dia CI water pipeline and improve water facilities and to aviod frequent Contamination Complaint in New Tharagupet in K R Market ward 139 coming under Chamarajapet service station of AEESW-2 Sub Division

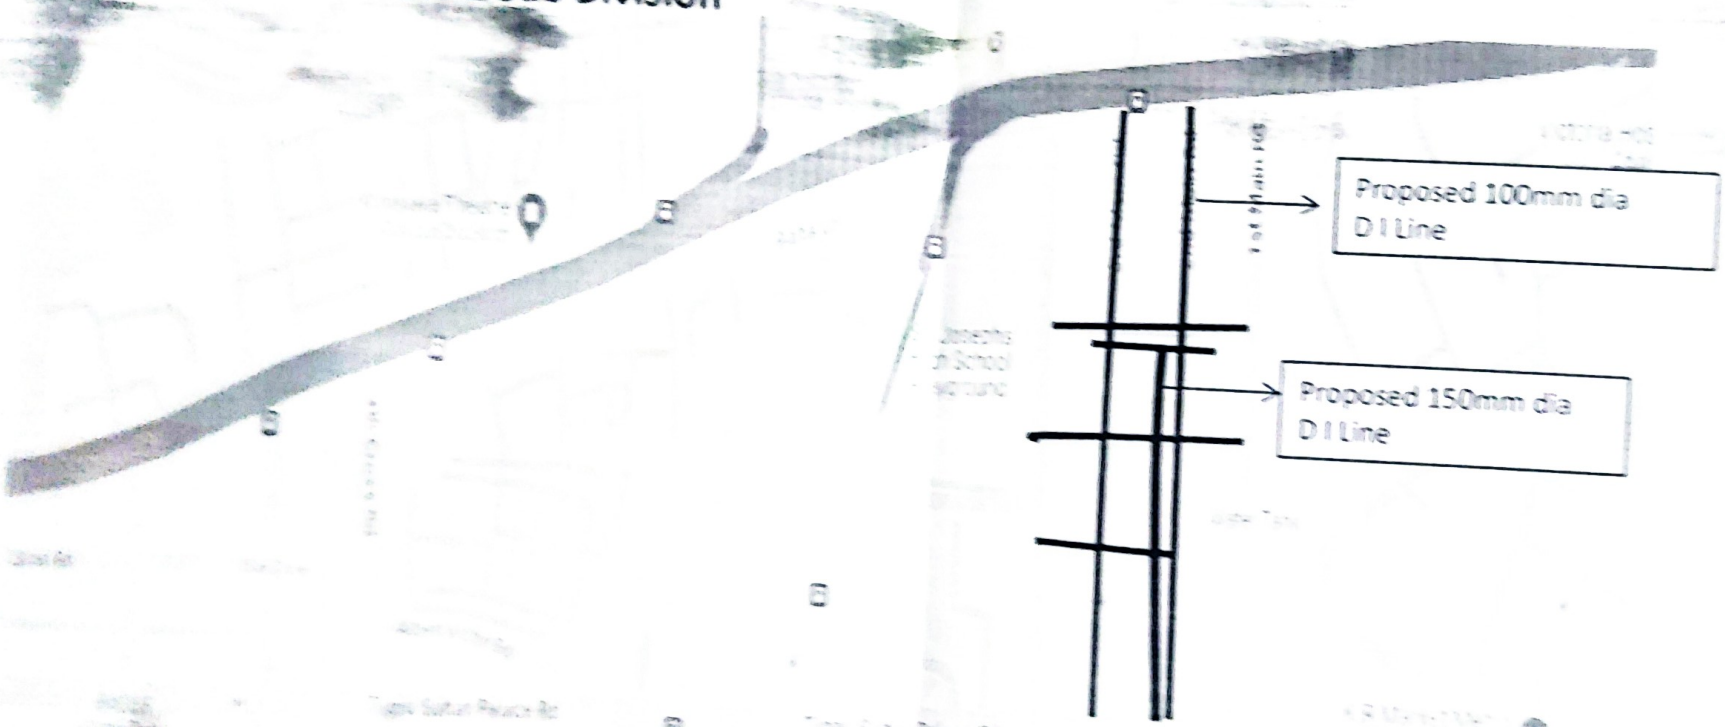

AE/CPET

AEESW-2

EESW-1

Scanned with ACE Scanner